

## NOZZLE SCHEDULE - DSW5000/7000/10000

ITEM	DN SIZE	ITEM DESCRIPTION	POSITION	
N1	-	415mm SEALED HDPE LID c/w MUSHROOM BREATHER VENT - TYPE 2 - 50MM MALE	0° ROOF	
N2	50	GALVANISED STEEL PIPE ASSY, 2" BRASS BALL VALVE , 2" CHECK VALVE & 45° 2" ALUMINIUM CAMLOCK - TOP FILL ASSEMBLY		
N3	-	CLOCK DIAL LEVEL INDICATOR	0° ROOF	
N4	50	2" BRASS BALL VALVE - OUTLET c/w HDPE PROTECTION COVER	0°	

## NOTES:

- 1.
- USER TO REFER TO RELEVANT TANK INSTALLATION GUIDE. ALL FITTINGS/CONNECTIONS ARE TO BE INDEPENDENTLY SUPPORTED AND ISOLATED SO THAT ANY 2. LOADS ASSOCIATED WITH EXTERNAL PIPE WORK ARE NOT TRANSMITTED TO TANK. INSPECTION PORT POSITION IS FIXED & MUST REMAIN AS 0° REFERENCE POINT
- 3. 4.
- ALL NOZZLES ARE TO BE IN DEGREES MOVING CLOCKWISE FROM 0°.

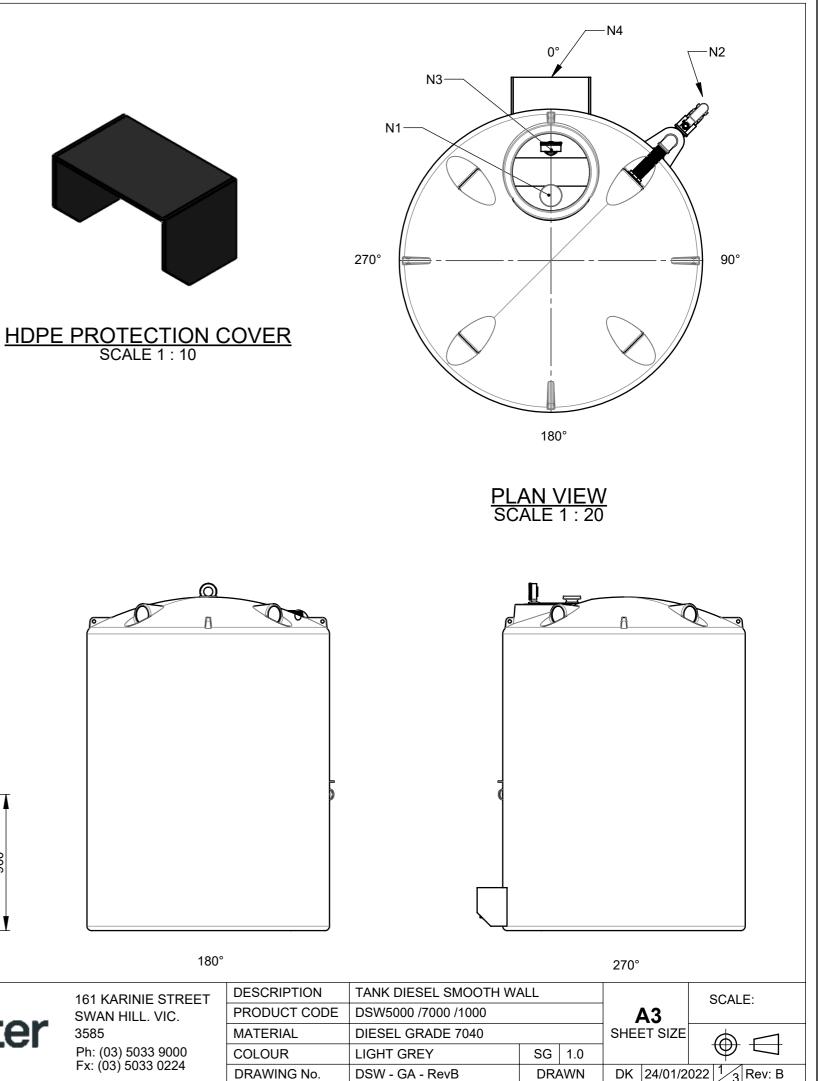


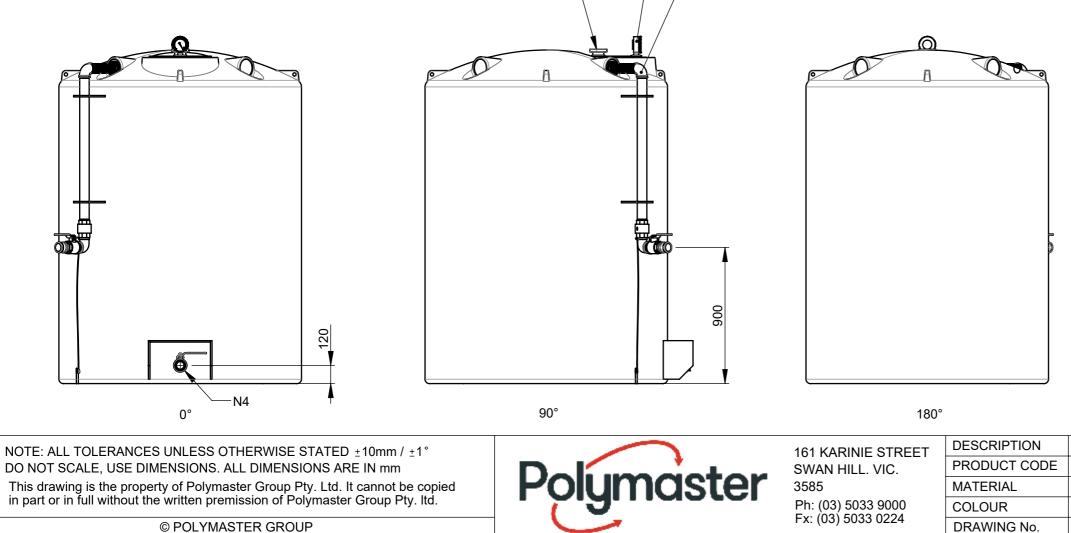


N1-

N3-

N2

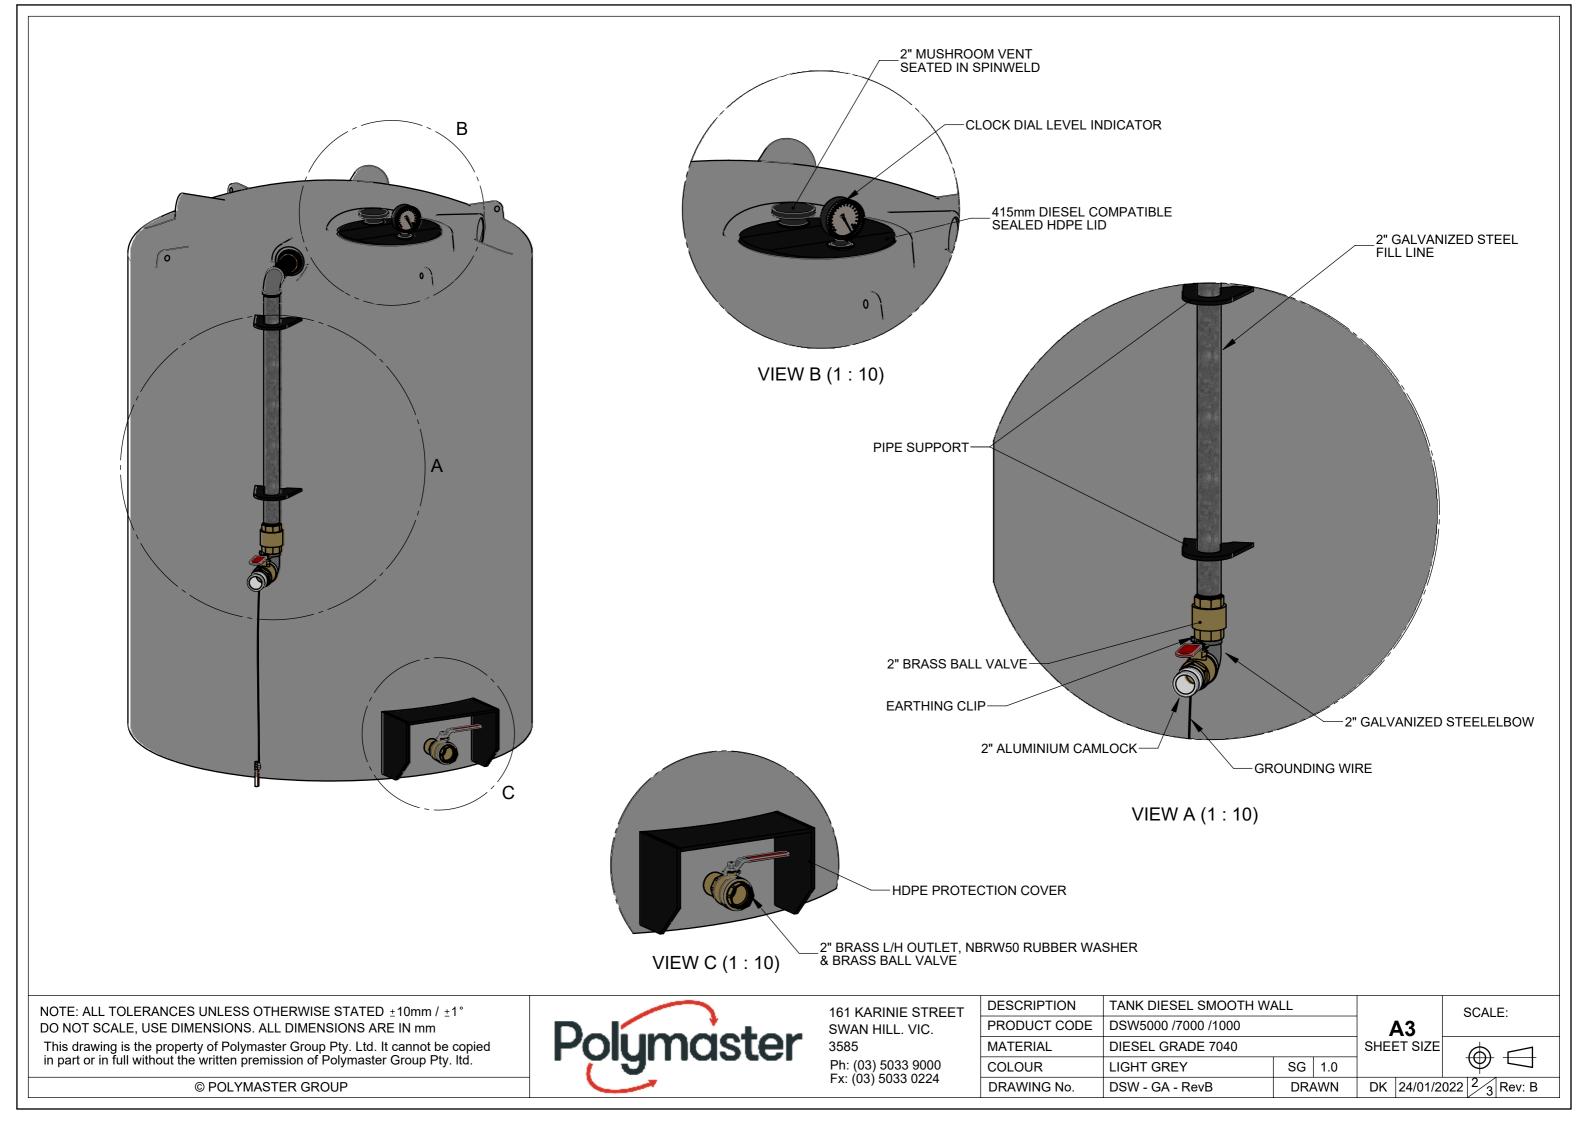

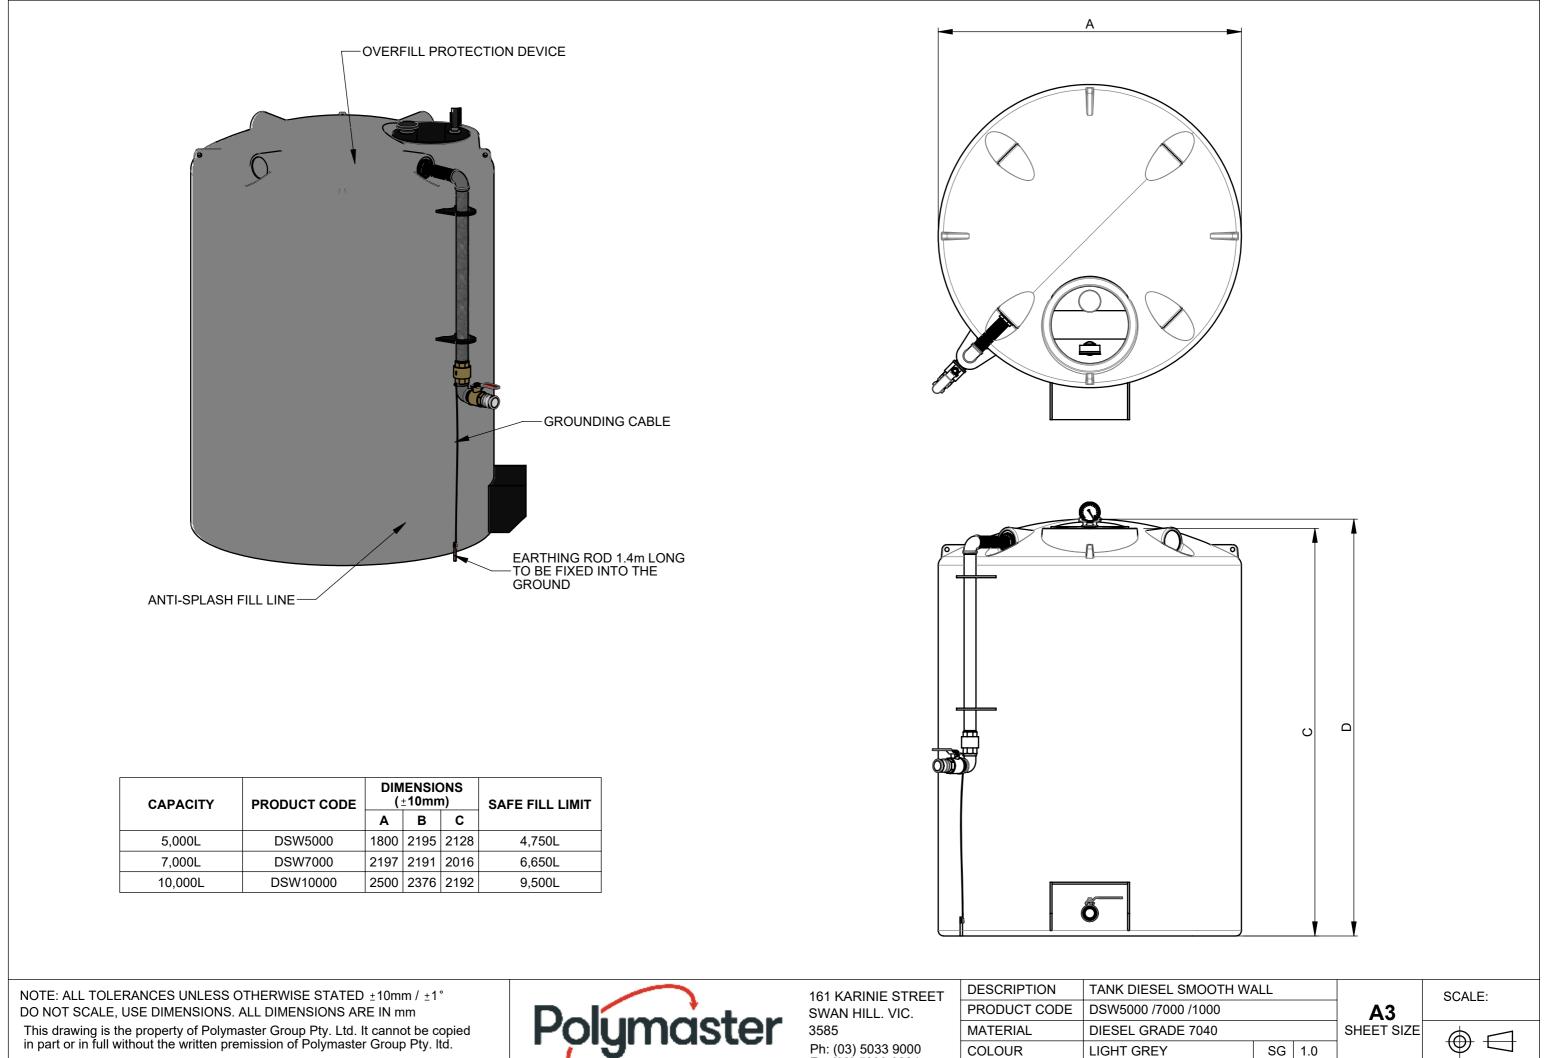

Ph: (03) 5033 9000 Fx: (03) 5033 0224

	DESCRIPTION	TANK DIESEL SMO		
	PRODUCT CODE	DSW5000 /7000 /1		
	MATERIAL	DIESEL GRADE 70		
	COLOUR	LIGHT GREY		
	DRAWING No.	DSW - GA - RevB		

DK 24/01/2022 3 3 Rev: B

DRAWN

© POLYMASTER GROUP